SUPPLEMENTARY MATERIAL

Figure 1. *Biomek apparatus used for antimicrobial activity tests* *2*

Figure 2. *Anticandidal activity results against Candida tropicalis (isolate, Osmangazi University, Eskişehir)* *2*

Figure 3. *The ^{1}H-NMR spectrum of the compound* ***3f*** *3*

Figure 4. *The ^{13}C-NMR spectrum of the compound* ***3f*** *4*

Figure 5. *The 1H-NMR spectrum of the compound* ***3o*** *5*

Figure 6. *The 13C-NMR spectrum of the compound* ***3o*** *6*

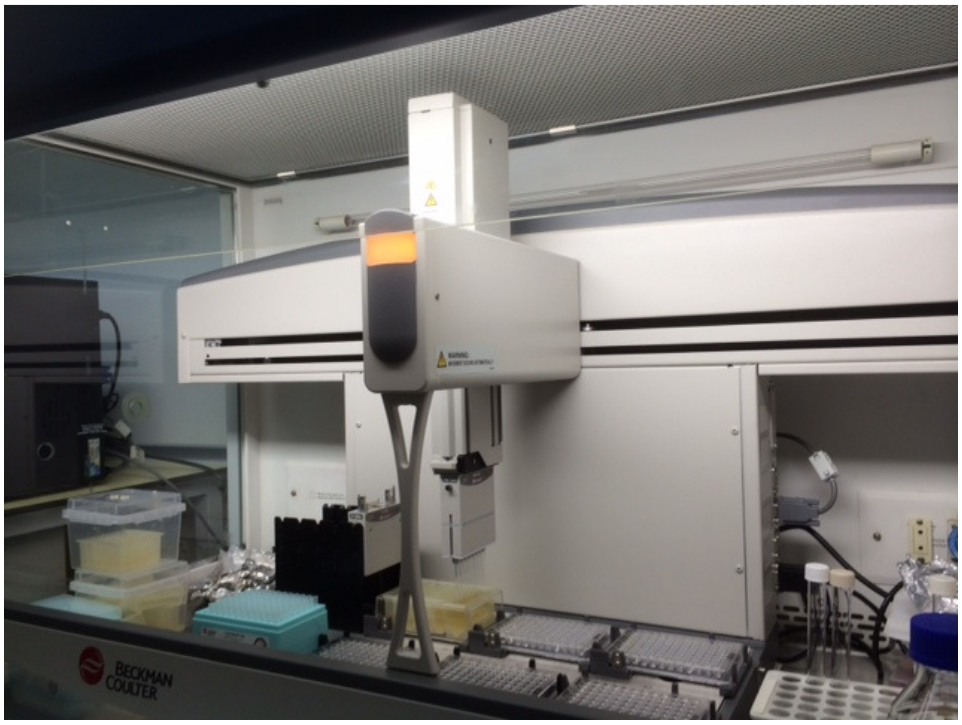

Figure 1. Biomek apparatus used for antimicrobial activity tests

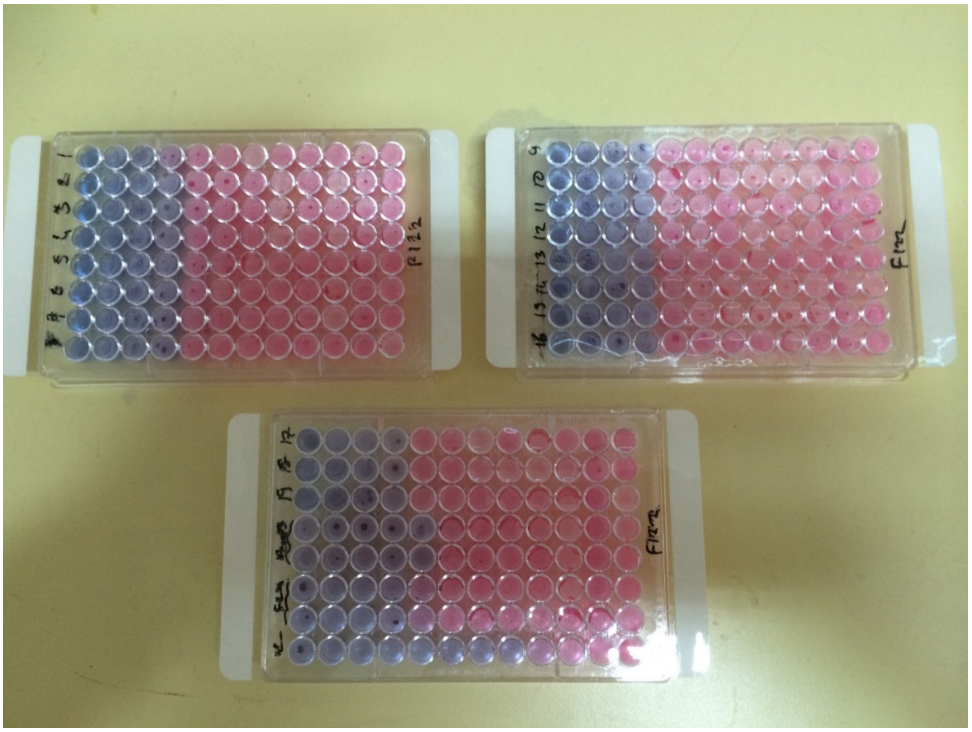

Figure 2. Anticandidal activity results against *Candida tropicalis* (isolate, Osmangazi University, Eskişehir)

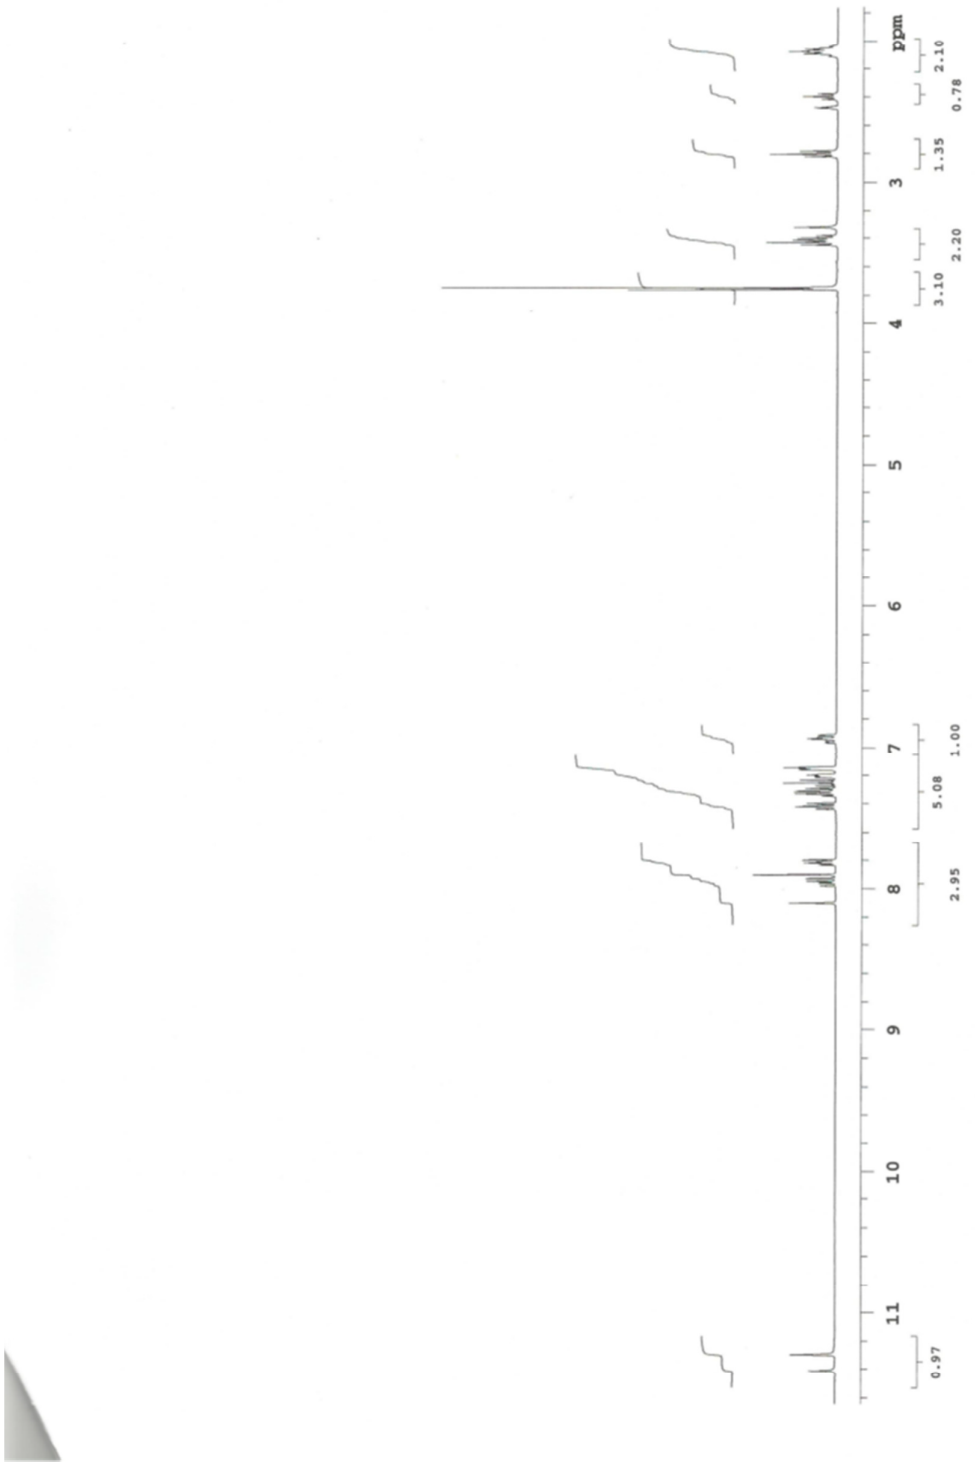

Figure 3. The ^{1}H-NMR spectrum of the compound **3f**

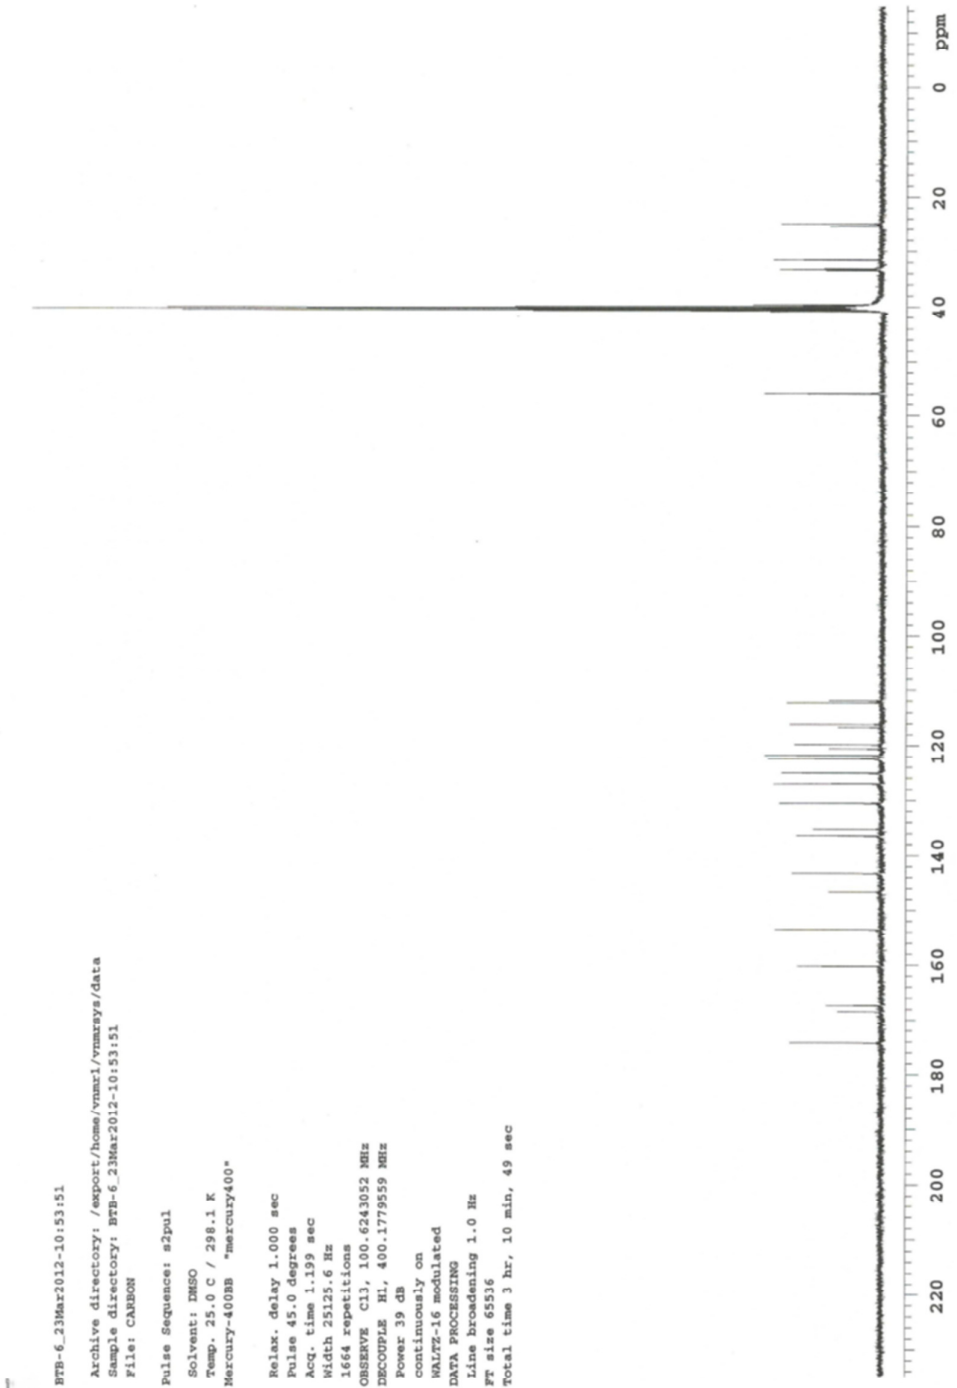

Figure 4. The ^{13}C-NMR spectrum of the compound **3f**

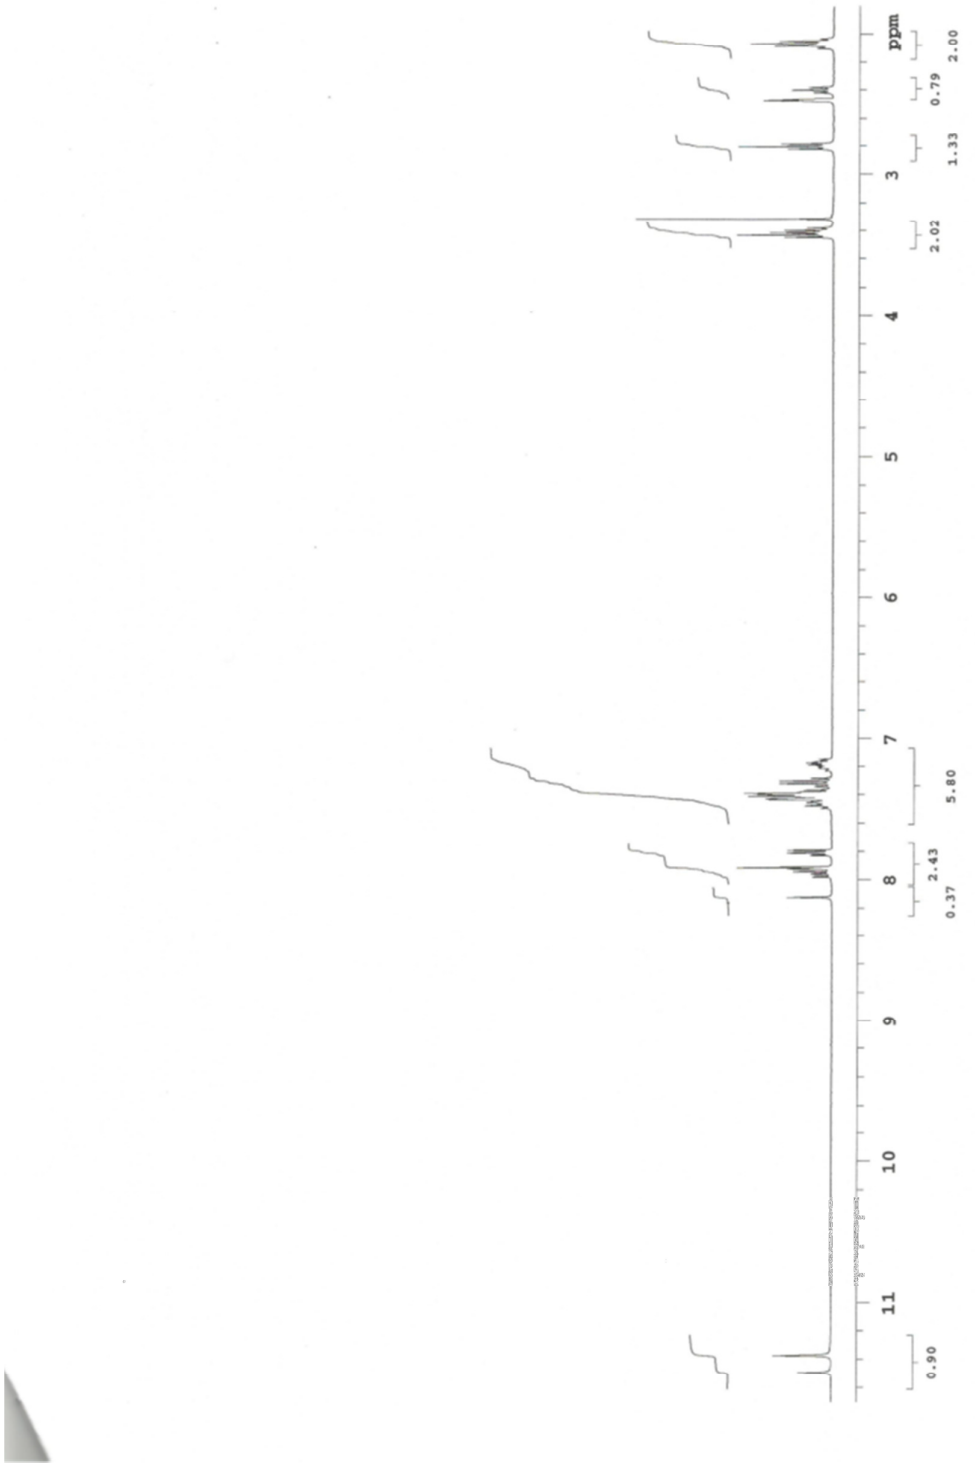

Figure 5. The ^{1}H-NMR spectrum of the compound **3o**

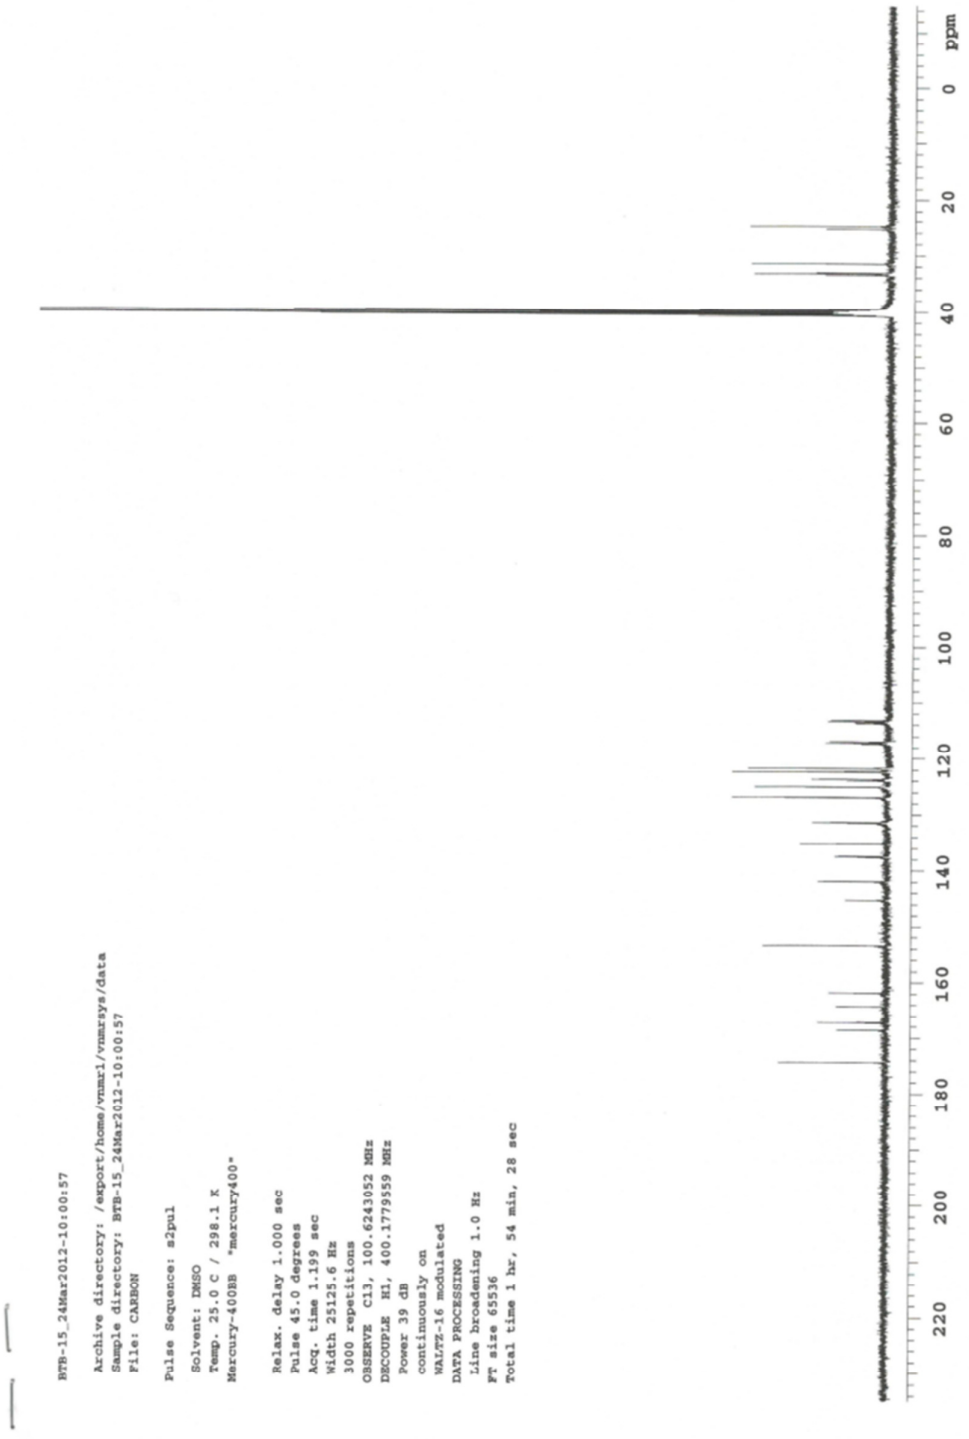

Figure 6. The ^{13}C-NMR spectrum of the compound **3o**